


Cabinet Design

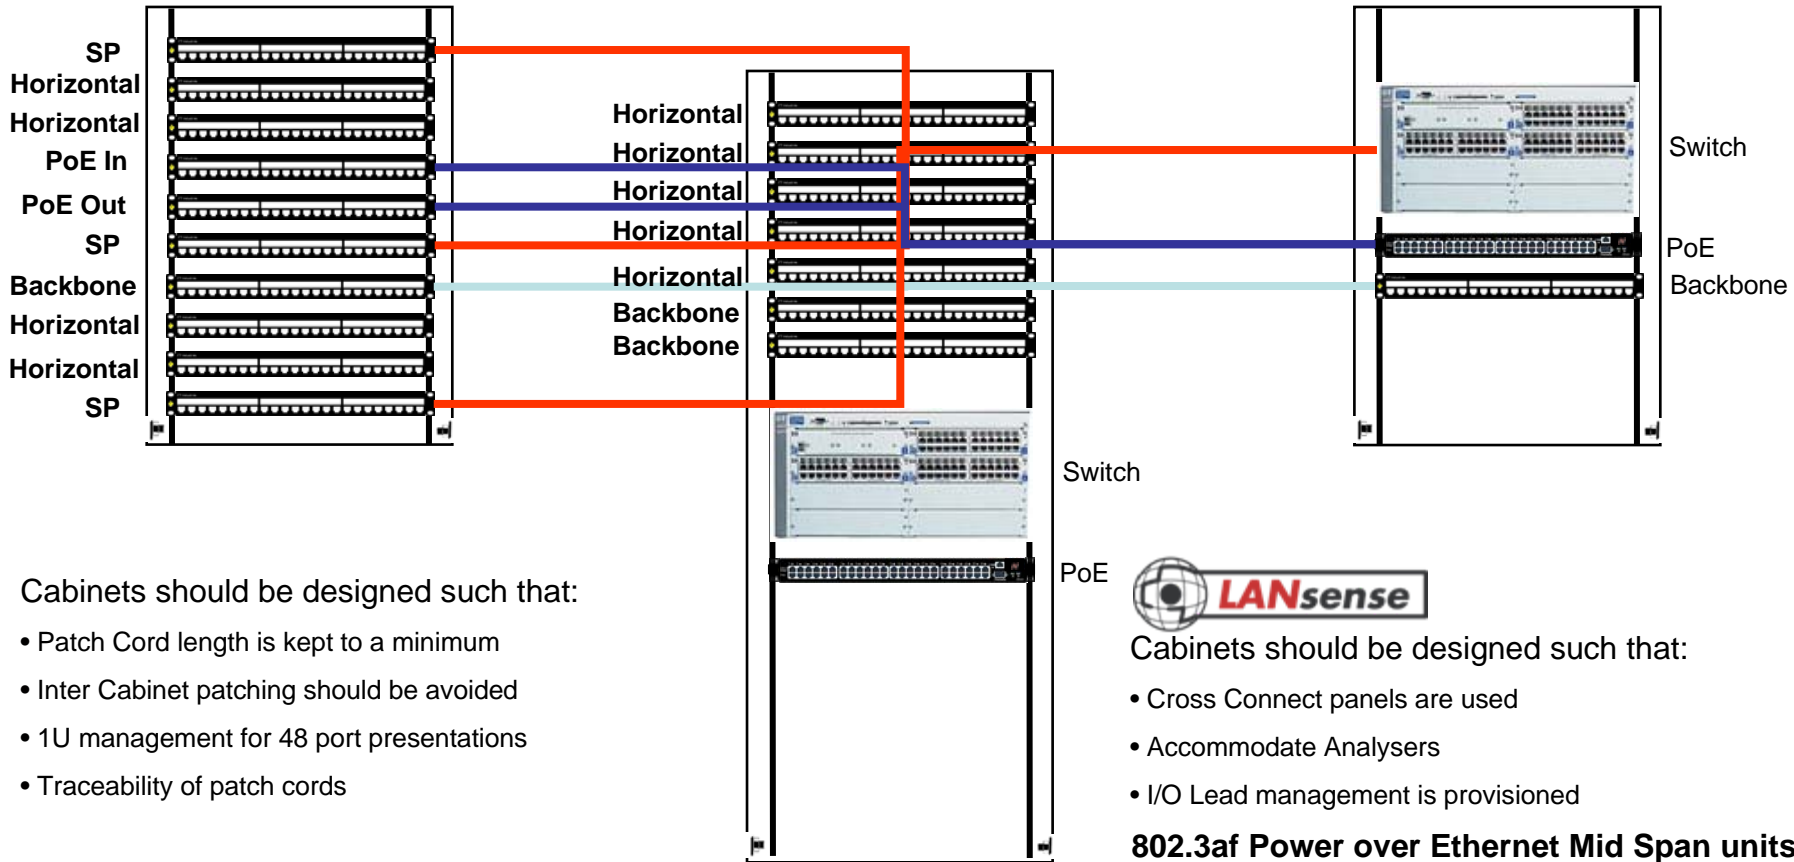

Cabinets should be designed such that:

- Patch Cord length is kept to a minimum
- Inter Cabinet patching should be avoided
- 1U management for 48 port presentations
- Traceability of patch cords

Cabinets should be designed such that:

- Cross Connect panels are used
- Accommodate Analysers
- I/O Lead management is provisioned

802.3af Power over Ethernet Mid Span units

Cabinets should be designed such that:

- Accommodate hardware
- Extra cable management